

2011.3.19 19:00

(Bq/kg)

	Prefecture	Tap Water	
		I-131	Cs-137
1	Hokkaido (Sapporo City)	Not Detectable	Not Detectable
2	Aomori (Aomori City)	Not Detectable	Not Detectable
3	Iwate (Morioka City)	Not Detectable	Not Detectable
4	Miyagi	-	-
5	Akita (Akita City)	Not Detectable	Not Detectable
6	Yamagata (Yamagata City)	Not Detectable	Not Detectable
7	Fukushima	-	-
8	Ibaraki	-	-
9	Tochigi (Utsunomiya City)	77	1.6
10	Gunma (Maebashi City)	2.5	0.22
11	Saitama (Saitama City)	0.62	Not Detectable
12	Chiba (Ichihara City)	0.79	Not Detectable
13	Tokyo (Shinjuku Ward)	1.5	Not Detectable
14	Kanagawa (Chigasaki City)	Not Detectable	Not Detectable
15	Niigata (Niigata City)	0.27	Not Detectable
16	Toyama (Imizu City)	Not Detectable	Not Detectable
17	Ishikawa (Kanazawa City)	Not Detectable	Not Detectable
18	Fukui (Fukui City)	Not Detectable	Not Detectable
19	Yamanashi (Kofu City)	Not Detectable	Not Detectable
20	Nagano (Nagano City)	Not Detectable	Not Detectable
21	Gifu (Kakamigahara City)	Not Detectable	Not Detectable
22	Shizuoka (Shizuoka City)	Not Detectable	Not Detectable
23	Aichi (Nagoya City)	Not Detectable	Not Detectable
24	Mie (Yokkaichi City)	Not Detectable	Not Detectable
25	Shiga (Otsu City)	Not Detectable	Not Detectable
26	Kyoto (Kyoto City)	Not Detectable	Not Detectable
27	Osaka (Osaka City)	Not Detectable	Not Detectable
28	Hyogo (Kobe City)	Not Detectable	Not Detectable
29	Nara	Not Yet Reached	Not Yet Reached
30	Wakayama (Wakayama City)	Not Detectable	Not Detectable
31	Tottori (Tohaku District)	Not Detectable	Not Detectable
32	Shimane (Matsue City)	Not Detectable	Not Detectable
33	Okayama (Okayama City)	Not Detectable	Not Detectable
34	Hiroshima (Hiroshima City)	Not Detectable	Not Detectable
35	Yamaguchi (Ube City)	Not Detectable	Not Detectable
36	Tokushima (Tokushima City)	Not Detectable	Not Detectable
37	Kagawa (Takamatsu City)	Not Detectable	Not Detectable
38	Ehime (Yawatahama City)	Not Detectable	Not Detectable
39	Kochi (Kochi City)	Not Detectable	Not Detectable
40	Fukuoka (Dazaifu City)	Not Detectable	Not Detectable
41	Saga (Saga City)	Not Detectable	Not Detectable
42	Nagasaki (Omura City)	Not Detectable	Not Detectable
43	Kumamoto (Uto City)	Not Detectable	Not Detectable
44	Oita (Oita City)	Not Detectable	Not Detectable
45	Miyazaki (Miyazaki City)	Not Detectable	Not Detectable
46	Kagoshima (Kagoshima City)	Not Detectable	Not Detectable
47	Okinawa (Naha City)	Not Detectable	Not Detectable

\*Reading of Miyagi, Fukushima and Ibaraki are not measured because of the damage by earthquake. (Please see the web-page of the Disaster Provision Main Office of Fukushima Pref, "http://www.pref.fukushima.jp/j/index.htm")

\*Blanks are caused by device clearance, but the area was measured by Moni Posts.


\*These data are estimated as 1Bq/litter = 1Bq/kg

\*The table was made by MEXT, based on the reports from prefectures.

\*"Emergency Preparedness for Nuclear Facilities (The Nuclear Safety Commission of Japan)", The index of drinking water based on the indicator about the restriction of food intake, I-131: More than 300Bq/kg, Cs-137: More than 200Bq/kg

# Radiation in Daily-life

※Unit :  $\mu\text{Sv}$

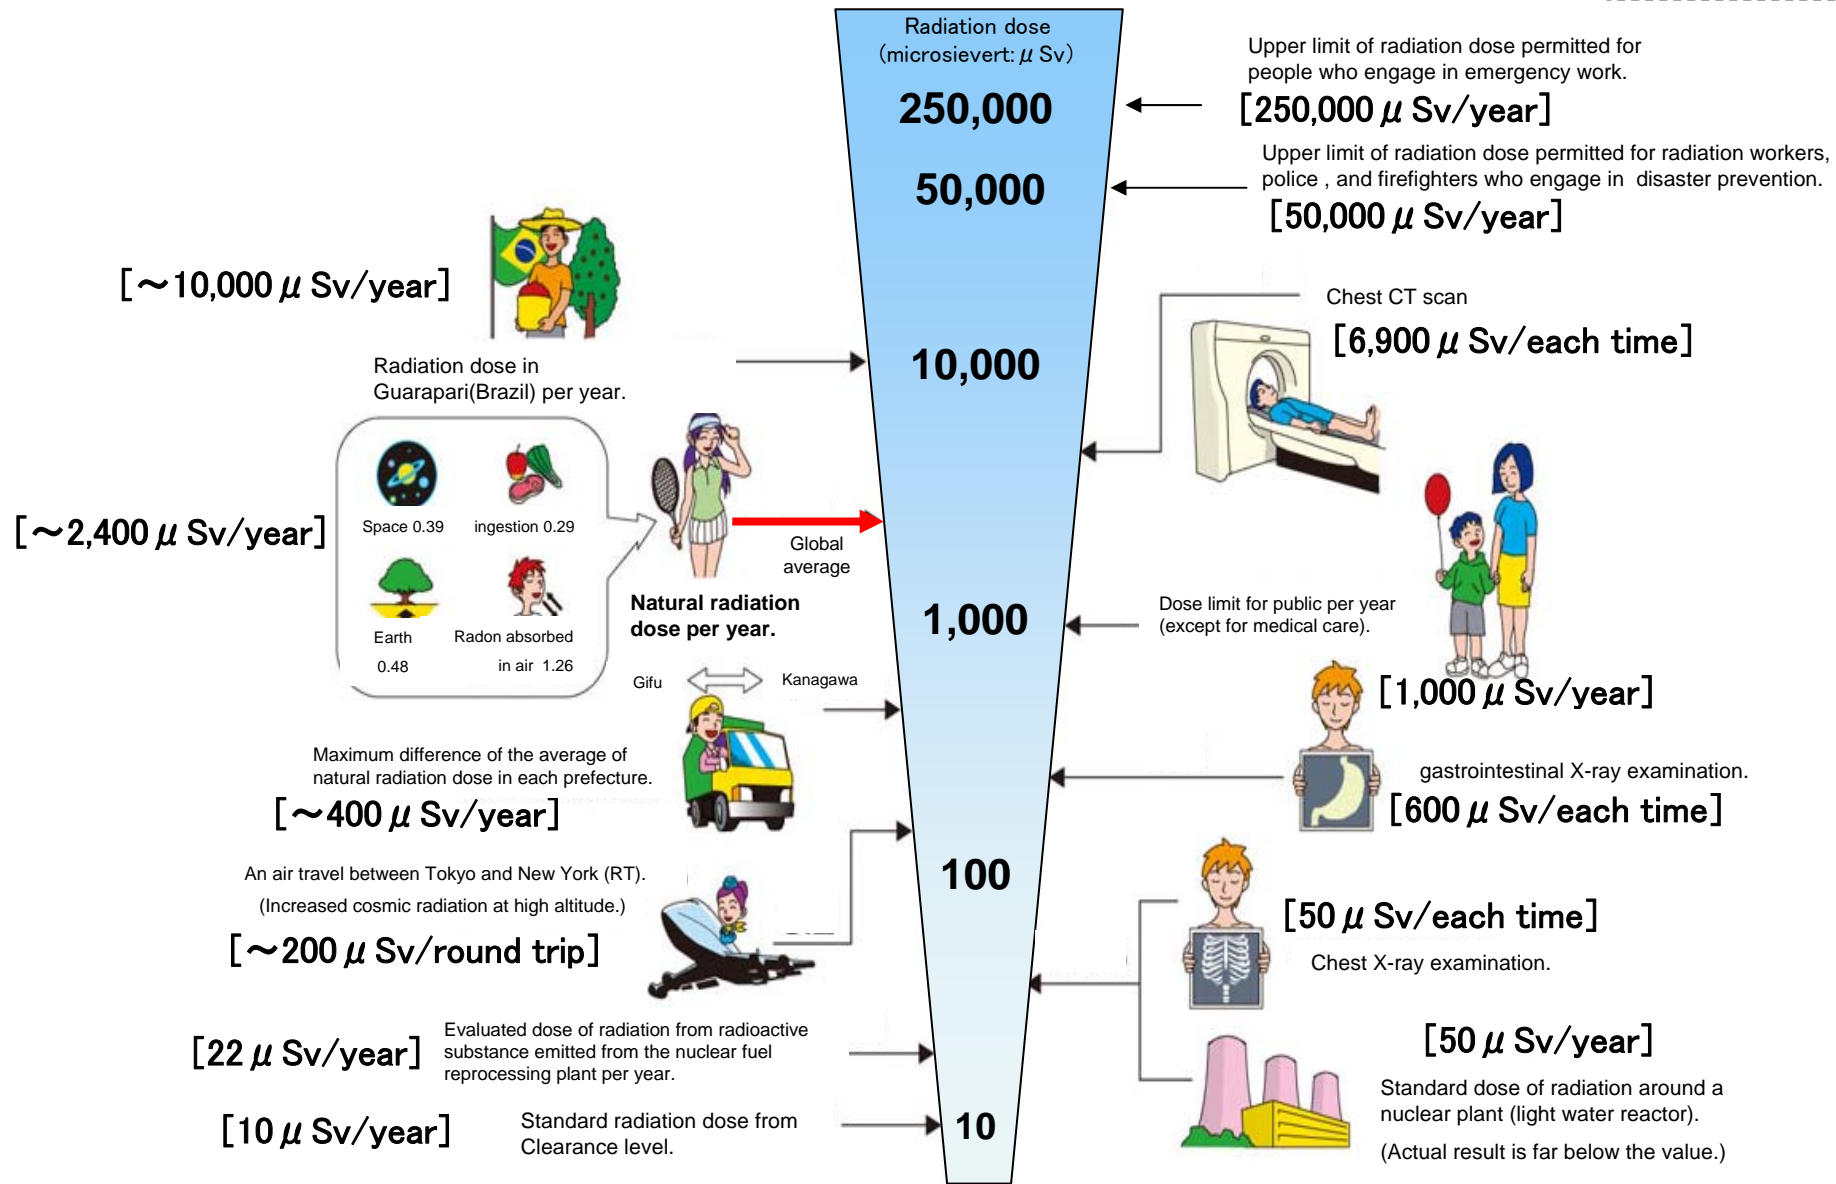

(Ref) Average dose rate at the monitoring post of Tokyo (3/17 9:00~3/18 9:00, March) :  $0.050 \mu\text{Sv}/\text{h} = 438 \mu\text{Sv}/\text{y}$